



Industrie Service

# CERTIFICATE

(Certificate of conformity with technical requirements in: )  
**API STANDARD 607 Eighth Edition, October 2022**

Certificate No.:296202

Ref. Test report No.: 296201

Name and postal address of manufacturer: **ANIX VALVE GROUP CO., LTD.**  
**No. 422, Binhai 22 Road, Wenzhou Economic Development**  
**Zone, Wenzhou City, Zhejiang Province**

We hereby certify that the fire test on below valves have been conducted at the laboratory designated by manufacturer and witnessed by TÜV SÜD inspector according to requirements of API STD 607 Eighth Edition, October 2022. The testing results of valves meet the requirements of API STD 607 Eighth Edition, October 2022.

## 1. Description of Test Valve :

Type of Test Valve	4" CL150 Ball Valve
Description of Test Valve	Ball Valve
Valve Size (NPS)	4"
Pressure Rating ( Class )	150
Valve Body Material	CF8

## 2. Qualified Range of Valves :


Type	Ball Valves
Description of Valves	Ball Valves
Qualified Sizes ( NPS ) ( according to API 607 Table 3 )	4", 5", 6", 8"
Qualified Pressure Ratings (Class) ( according to API 607 Table 4 )	Class 150; Class 300;
Qualified Valve Material	Austenitic, ASME B16.34 material groups 2.1 through 2.5
Remark: the technical data of tested valves see back of this certificate appendix 1.	

This certificate is issued according to API STD 607 Eighth Edition, October 2022, based upon the result of testing report on above mentioned test valve. The additional valve qualification shall be limited on similar valves of same basic design and construction as the test valves and of the same nonmetallic materials as the test valve in the seat-to-closure member seal, seat-to-body seal, stem seal, and body joint and seal according to API STD 607 Eighth Edition, October 2022, Paragraph 7.

**Shanghai, Jun. 6, 2023**  
(Place, date)

**Zhenrong Xie**  
**TÜV SÜD Industrie Service GmbH**

Westendstr.199  
80686 München Germany





Industrie Service

## Appendix 1:

Certificate No.: 296202

Ref. Test report No.: 296201

Name and postal address of manufacturer: **ANIX VALVE GROUP CO., LTD.**  
**No. 422, Binhai 22 Road, Wenzhou Economic Development Zone,**  
**Wenzhou City, Zhejiang Province**


### Technical Data of Valve

1. Type of Test Valve: 4" CL150 Ball Valve
2. Description of Test Valve: 4" CL150 Ball Valve
3. Details of Valve:

Valves Size ( NPS ) Material Part Name	4"
Bonnet	CF8
Bolt	A193 B8
Nut	A194 8
Ball	304
Body	CF8
Stem	F304
Packing	GRAPHITE
Seat	RPTFE
Body Seal ring	SS+GRAPHITE
Anti-wear gasket	RPTFE
Gland	CF8
Design Drawing No.:	100 FQ41F-150LB-00

**Shanghai, Jun. 6, 2023**  
(Place, date)

**Zhenrong Xie**  
**TÜV SÜD Industrie Service GmbH**



TÜV SÜD Industrie Service GmbH  
Shanghai Office  
Floor 3-13, No.151, Heng Tong Road,  
Shanghai 200070 P. R. China

Tel.: +86 21 6141-0123  
Fax: + 86 21 6140-8600



## Test Report

(Valve Fire Test According to API STANDARD 607 Eighth Edition, October 2022.)

Certificate No. : 296202  
Test Report No.: 296201

Applicant / Manufacturer: ANIX VALVE GROUP CO., LTD.  
No. 422, Binhai 22 Road, Wenzhou Economic Development Zone, Wenzhou City,  
Zhejiang Province

Inspection body: TÜV SÜD Industrie Service GmbH  
Floor 3-13, No.151, Hengtong Road, Shanghai, P. R. China

Test Date: Apr. 14. 2023

Description of valves: Ball Valve 4"-CL150  
Size: 4"  
Pressure Rating: Class 150  
Drawing No.: 100 FQ41F-150LB-00

Test Witnessed By: Wang Zhongxiang / TÜV SÜD Inspector




Test Report No.:296201

## Inspection and Tests

### 1. Conformity of Equipment

The test equipment was verified by TÜV SÜD inspector according to requirements of API STANDARD607 Eighth Edition, October 2022. Para.5.3 and found satisfactory. The detail arrangement of the fire-test equipment is shown below:

**Figure 1.** Typical Fire-Test System Using a Pump as the Pressure Source

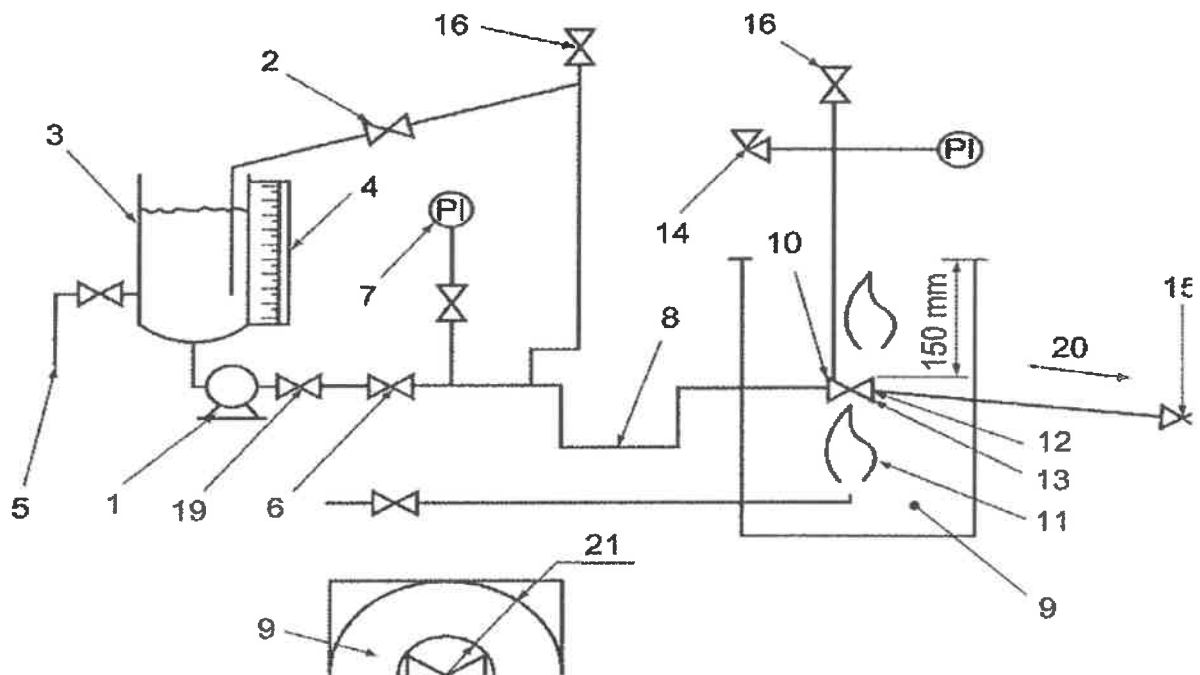

### Key

- |  |  |                      |
|--|--|----------------------|
| 1. Pressure source                       | 10. Test valve mounted horizontally with stem in horizontal position | 19. Check valve      |
| 2. Pressure regulator and relief         | 11. Fuel gas supply and burner                                       | 20. Slope            |
| 3. Vessel for water                      | 12. Calorimeter cubes  | 21. Clearance: 150mm |
| 4. Calibrated sight gauge                | 13. Flame environment and body thermocouples                         |                      |
| 5. Water supply                          | 14. Pressure gauge and relief valve                                  |                      |
| 6. Shutoff valve                         | 15. Shut-off valve   |                      |
| 7. Pressure gauge                        | 16. Vent valve   |                      |
| 8. Piping arranged to provide vapor trap | 17. Condenser  |                      |
| 9. Enclosure for test                    | 18. Container  |                      |





**Test Report No.:296201**

**2. Calibration of measurement and test instrument**

The measurement and test instrument have been properly calibrated such as pressure gauges, thermocouples, etc.

**3. Technical Data of Test Valve:**

**a) Description of test valve**

Type of Test Valves	4" CL150 Ball Valve
Description of Valves	Ball Valve
Pressure Rating, Class	150
Valve Size, NPS	4"
Face to face dimension	ASME B16.10
End Flange Connection	ASME B16.5
Pressure Test	API 598
Designed Standard	ASME B16.34

**b) Details of technical data on test valve**

Part Name	Materials
Bonnet	CF8
Bolt	A193 B8
Nut	A194 8
Ball	304
Body	CF8
Stem	F304
Packing	GRAPHITE
Seat	RPTFE
Body Seal ring	SS+GRAPHITE
Anti-wear gasket	RPTFE
Gland	CF8
Design Drawing No.:	100 FQ41F-150LB-00







## Test Report No.:296201

### 4. Visual and dimensional Check on Valve Specimen:

The specimen valve was chosen at random by the manufacturer in its workshop and submitted to the laboratory. The visual and dimensional check was performed according to drawing No. 100 FQ41F-150LB-00 and results found satisfactory. The mark was verified on valve as following:

-- FQ41F Ball Valve 4" 150 CF8 ANIX VALVE GROUP CO., LTD.

Manufacturer's Brand	TYPE	NAME	Size	Class	Material	Company
----------------------	------	------	------	-------	----------	---------

### 5. Document Review:

The chemical and mechanical test report of castings was reviewed and found satisfactory. Also the inspection report of shell test, seat test and pneumatic test was reviewed and found.

### 6. Preparation before testing:

- 6.1 The thermocouples and calorimeters were installed properly according to Figure 1,2,3,4 in API 607. Two thermocouples (part 13) are installed to measure flame temperature, one is located under valve body, another is located under valve stem, both within 1". Two calorimeters (part 12) are positioned to the same place as the thermocouples do.
- 6.2 The test system including test valve (part 10) was cleaned through by water before testing. All air was purged from test valve and testing system by water.
- 6.3 The test system was pressurized to 3.0 MPa after the test valve and system upstream of valve have been completely full of water and system downstream of the test valve have been completely empty of water. The system and test valve were carefully checked for leakage when the test pressure was held at 3.0 MPa. No leakage was found on system and test valve.

### 7. Fire Test:

The fire test was conducted according to API STANDARD607 Eighth Edition, October 2022. Section 5. The pressure of the system upstream was increased to 0.20 MPa, then the fire ignited. The flame temperature reached 750°C within 2 minutes after ignition. The test pressure and temperature were maintained at 0.20 MPa during the fire test. The temperature and pressure were recorded continuously by the operators. The system and test valve was cooled to below 100°C within 10 mins of the extinguishing fire by shower nozzles after 30 mins' fire test and the cooling time was 10mins. The loss of water weight in vessel was measured by weighing scale and water in calibrated container (part 18) were read and recorded. The test result is shown as below:





**Test Report No.:296201**

**Test result of fire test**

Item	API 607 Required Value	Actual Value
Test Pressure ( MPa )	0.20 MPa	0.22MPa
Test Temperature	750 ~ 1000°C	790~ 860 °C
Through-seat leakage according to API 607 table 1	≤400 ml/min	278 ml/min
Total time from fire test to cooling down	40 min	
External Leakage during burn & cool down	≤100 ml/min	78 ml/min
Conclusion: the test result is satisfactory according to API 607.		

**8. Low pressure test:**

Decrease & stabilize the pressure to the low test pressure at 0.2MPa, measured and recorded the through seat leakage over a 5mins period to API STANDARD607 Eighth Edition, October 2022.Para. 6.4 and 5.6.15. The test result was recorded as below:

**Test result of low pressure test**

Item	API 607 Required Value	Actual Value
Test Pressure ( MPa )	0.2 MPa	0.22 MPa
Test Temperature	30°C	
Test Time	5 min	
Through Seat Leakage	≤160ml/min	29 ml/min
Conclusion: the test result is satisfactory according to API 607.		

The valves was operated against the low pressure at 0.2MPa to fully open position and then to the fully closed.

The pressure was stabilized to the low test pressure at 0.2MPa, measured and recorded the through seat leakage over a 5mins period to API STANDARD607 Eighth Edition, October 2022.Para. 6.4 and 5.6.16. The test result was recorded as below:

**Test result of low pressure operation test**

Item	API 607 Required Value	Actual Value
Test Pressure ( MPa )	0.2 MPa	0.2 MPa
Test Temperature	30°C	
Test Time	5 min	
Through Seat Leakage	≤160ml/min	98 ml/min
Conclusion: the test result is satisfactory according to API 607.		





**Test Report No.:296201**

**9. Operational Test:**

The operational test was conducted according to API STANDARD607 Eighth Edition, October 2022. Para. 6.6 and 5.6.18. The upstream pressure was increased to 1.5 MPa then the test valve was fully opened against the high-test pressure differential to vent the piping and test valve body cavity to remove air or steam. The downstream shutoff valve was then closed and the system pressure was increased to and maintained at 1.5 MPa. Then measured and recorded external leakage for a period of five minutes after valve was in the open position at high test pressure. The test result was recorded as below:

Test result of operational test

Item	API 607 Required Value	Actual Value
Test Pressure ( MPa )	1.5 MPa	1.5 MPa
Test Temperature	30°C	
Test Time	5 min	
External Leakage	≤100 ml/min	45 ml/min
Conclusion: the test result is satisfactory according to API 607.		

The undersigned, hereby declare that I have checked test valve and witnessed the fire test on the test valve according to API STANDARD607 Eighth Edition, October 2022. The test result is satisfactory.

TÜV SÜD Industrie Service GmbH

*Wang Zhongxiang*



Wang Zhongxiang

Date: Jun. 6. 2023

**Annexes:**

- 1) Copy of Drawing No.: 100 FQ41F-150LB-00;
- 2) Copy of Test Record of Fire Test No.: (2023)WTJC-230065

